


REVISIONS			
Rev	by	Date	Comment
A	RA	14.12.2021	Updated to suit comments
B	RA	16.12.2021	Updated to suit comments
C	RA	20.12.2021	Updated to suit comments

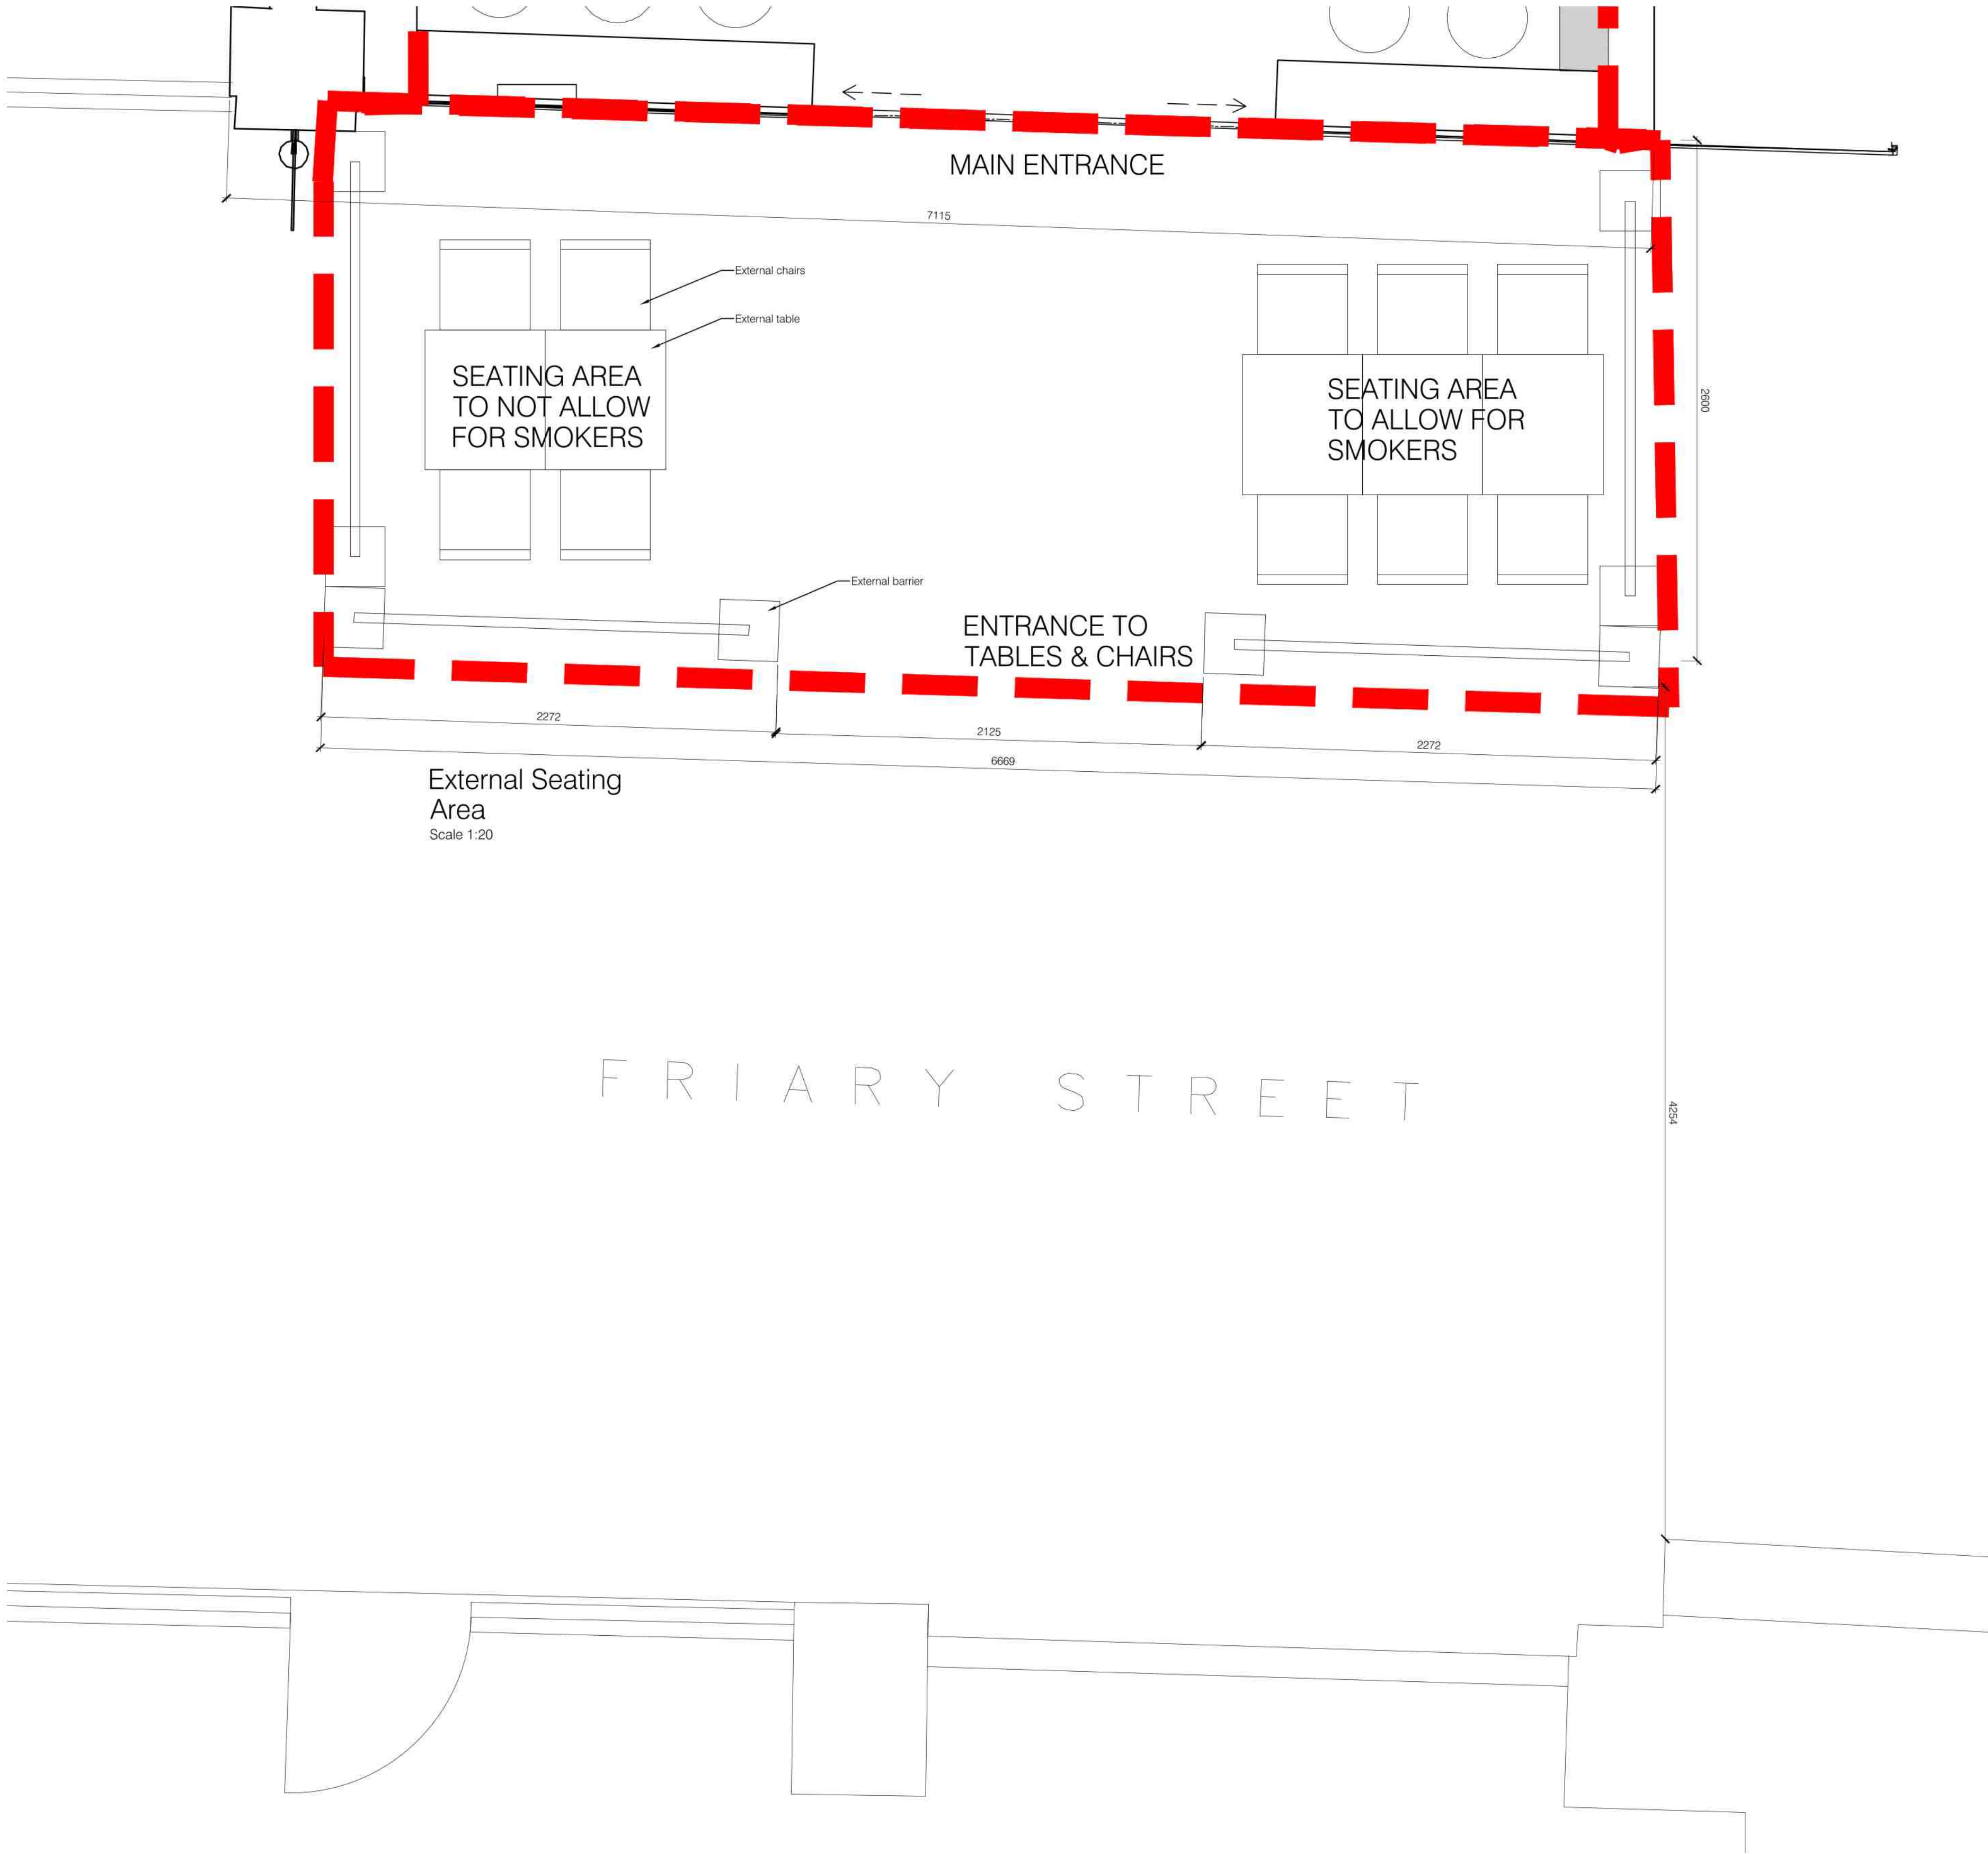

FIRE SAFETY INSTALLATION LEGEND		ITEM TBC BY FIRE ALARM SPECIALIST	ITEM TBC BY FIRE ELECTRICAL CONTRACTOR	ITEM TBC BY LANDLORD APPROVED SPECIALIST
	9 litre water extinguisher			
	9 litre foam extinguisher			
	2kg carbon dioxide extinguisher			
	Fire blanket			
	Fry fighter			
	Area covered by smoke detector (BS 5839)	/		
	Area covered by heat detector (BS 5839)	/		
	Smoke detector base sounder beacon	/		
	Area covered by void smoke detection system (BS 5839)	/		
	Indicator for void detector	/		
	Area covered by alarm sounder (to be agreed on site)	/		
	Strobe unit. Area covered visual alarm	/		
	Area covered by emergency luminaire. Certificates of compliance to B.S. 5839 (Fire Alarms) and/ or B.S. 5266 (Emergency Lighting) to be provided to the fire Authority.		/	
	Vision panel			
	FD30S (fitted with automatic closer)			
	FD60S (fitted with automatic closers)			
	Fire rated door grilles to match performance of the door			
	Push bar to open door mechanism			
	Door release linked to Fire Alarm, to BS EN 54 -11:2001			
	Fire alarm panel location TBC	/		/
	Fire alarm repeater panel location TBC	/		/
	Fire alarm call point (BS 5839)	/		/
	Sign - 'FIRE DOOR KEEP SHUT' - 75mm letters			
	Sign - 'FIRE DOOR KEEP LOCKED' - 75mm letters			
	Sign - 'FIRE EXIT KEEP CLEAR' - 75mm letters			
	Sign - internally illuminated 'FIRE EXIT' or graphic equivalent		/	/
	Directional arrow to be provided in the direction indicated		/	/
	30 minute Partition			
	60 minute Partition			
	DVR + Monitor - details TBC			
	Security camera			

KEY:

Area shown thus indicates - All Licensable Activities

PRELIMINARY

CLIENT	Boparan Restaurant Group
PROJECT	Slim Chickens Guildford Unit 22
TITLE	Proposed External Seating Area
DRAWN	CHECKED
RA	--
SCALE @ A1	DATE
As stated	July 2021
DRAWING NO.	
4877/60-2/C	